


PROBUILD

UPPER LEVEL BCI JOIST LAYOUT
FILE: 9-386-2 JOB: DELAERE

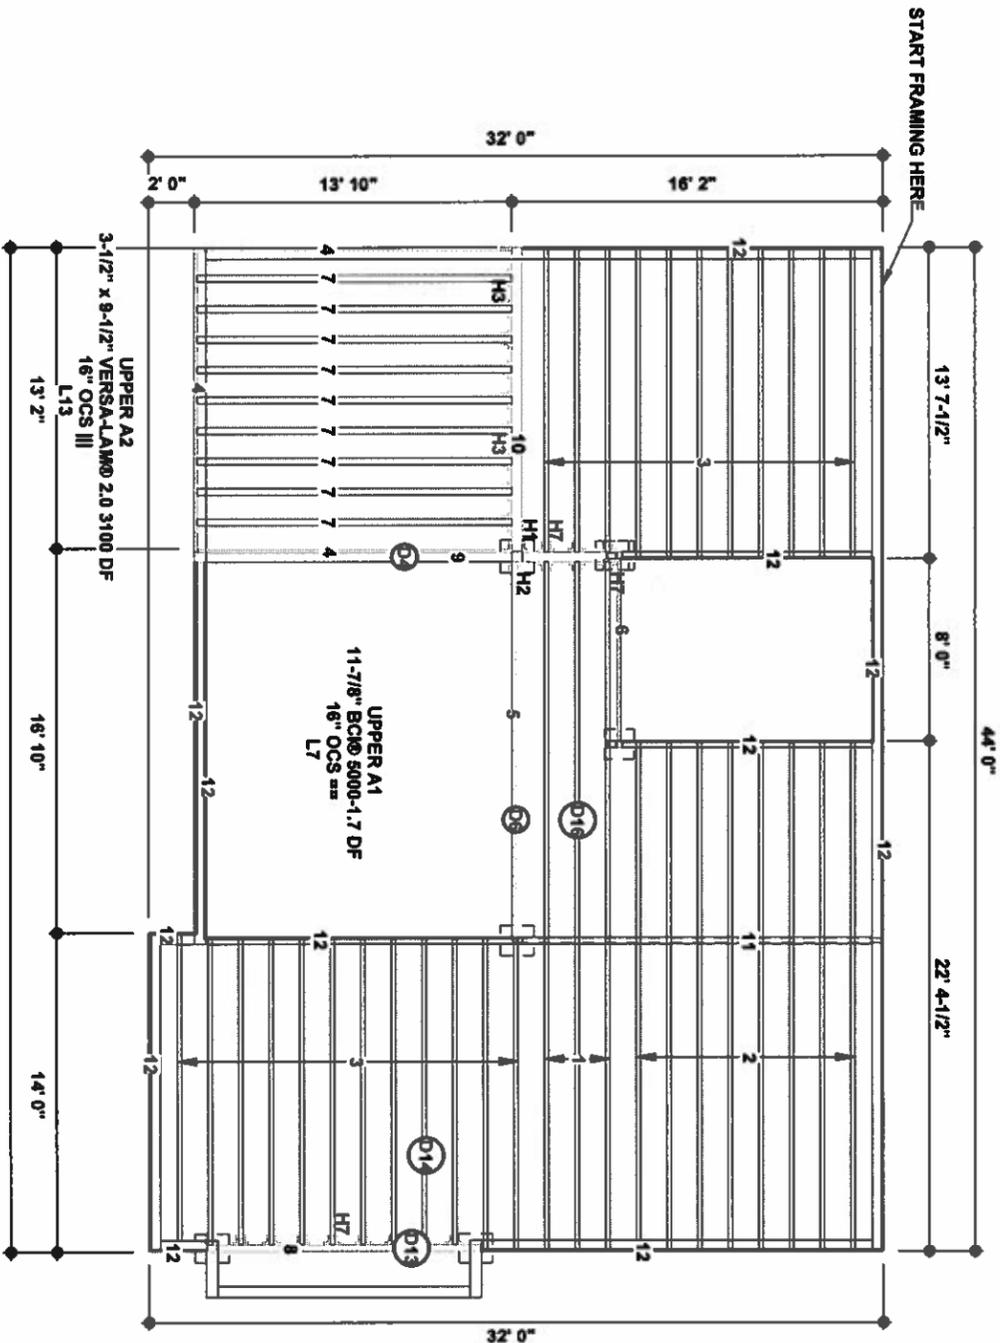

Tag	Qty	Description	Length
1	3	11-7/8" BCI@ 5000-1.7 DF	31' 0"
2	8	11-7/8" BCI@ 5000-1.7 DF	23' 0"
3	23	11-7/8" BCI@ 5000-1.7 DF	14' 0"
4	3	1-1/2" x 9-1/2" VERSA-LAM@ 2.0 2800 DF	14' 0"
5	1	1-3/4" x 11-7/8" VERSA-LAM@ 2.0 2800 DF	17' 0"
6	1	1-3/4" x 11-7/8" VERSA-LAM@ 2.0 2800 DF	9' 0"
7	9	3-1/2" x 9-1/2" VERSA-LAM@ 2.0 3100 DF	14' 0"
8	1	3-1/2" x 11-7/8" VERSA-LAM@ 2.0 3100 DF	12' 0"
9	1	6-1/4" x 11-7/8" VERSA-LAM@ 2.0 3100 DF	19' 0"
10	1	6-1/4" x 11-7/8" VERSA-LAM@ 2.0 3100 DF	14' 0"
11	BLK	11-7/8" BCI@ 5000-1.7 DF	16' 0"
12	TL	1" x 11-7/8" BC RIM BOARD™ OSB	180' 0"

Tag	Type	Live	Dead	Snow	Wind	Roof Live	Description
L2	Unf. Area	100%	90%	115%	133%	125%	Roof Load
L7	Unf. Area	40 psf	30 psf				Floor Load
L13	Unf. Area	60 psf	20 psf				Deck Load



CONTRACTOR NOTES:

- PLEASE VERIFY ALL DIMENSIONS
- ALL FOOTINGS PER DESIGNER'S PLAN UNLESS NOTED OTHERWISE (SEE LAYOUT)
- PER NEW IRC CODES BLOCKING IS REQUIRED AT ALL INTERMEDIATE BEARING
- USE CAUTION WHEN CUTTING FOR PLUMBING
- PROVIDE PROPER SUPPORT AT ALL SHEARWALLS
- ALL ROOF LOADS ASSUMED TO BEAR ON EXTERIOR WALLS ONLY; NO ROOF FRAMING PLAN PROVIDED AT TIME OF LAYOUT
- PLEASE NOTE P.T. MATERIAL CAN CAUSE HANGERS TO CORRODE Z-MAX, HOT GALVANIZED, OR STAINLESS STEEL HANGERS REQUIRED FOR USE WITH MANY TREATED PRODUCTS. PLEASE SEE MANUFACTURER'S RECOMMENDATIONS.
- RECOMMENDED DECKING:
 - 16" O.C.-3/4" DECKING MIN.
 - 24" O.C.-7/8" DECKING MIN.
 - 32" O.C.-1-1/8" DECKING MIN
- PLEASE VERIFY ALL CONDITIONS, LAYOUT WAS PRODUCED FROM INCOMPLETE DESIGNER'S PLANS


Tag	Qty	Manufacturer	Product	Description
H3	33	Durastrand	4" x 8" FLR DECKING	QUANTITY ESTIMATED
H1	1	Simpson Strong-Tie, Inc.	HGUS.50/10	FACE MOUNT LVL HANGER 12/CTN
H2	1	Simpson Strong-Tie, Inc.	HU11	SGL FACE MOUNT LVL HANGER 25/CTN
H3	9	Simpson Strong-Tie, Inc.	HU410	JOIST HANGER 25/CTN
H7	15	Simpson Strong-Tie, Inc.	IUS2.08/11.88	SINGLE FACE MOUNT HANGER 25/CTN

D# DENOTES BC CALC REFERENCE TAG




Do not use notch or end nailing

See Boise literature for vertical load capacity.




F01 Rim Joist Perp N.T.S.


See Boise literature for vertical load capacity.

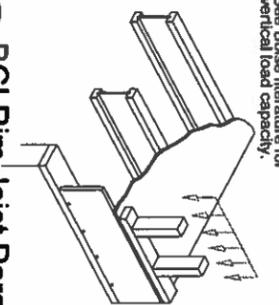


F07 RCI Rim Joist Para N.T.S.



F08 Post Load Transfer N.T.S.

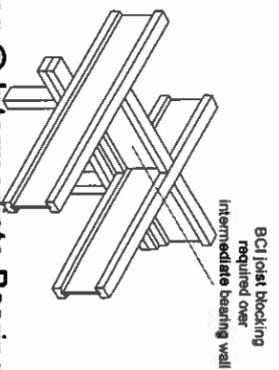

F09 @ Intermediate Bearing N.T.S.

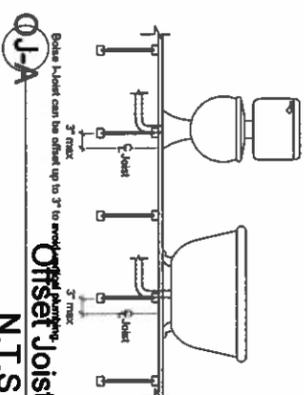

Offset Joist N.T.S.

SALES PRESENTATION DRAWING
No structural or dimensional check has been made with the design drawings of the building, therefore purchaser is to check and approve all dimensions, quantities, loads, and details carefully. This drawing has not been checked by Boise Engineering.




REVISIONS:	BY:
5/4/09	BH
5/19/09	BH

BC FRAMER@ 2.0
SCALE: 1/8" = 1'-0"
DATE: 5/19/2009
BY: BH
FILE: 9-386-2.lcd
DWG:
SHEET: 2 / 3

PROBUILD - THE DALLES
DELAERE
UPPER LEVEL BCI JOIST LAYOUT
BOISE CASCADE BMD
VANCOUVER, WA

PROBUILD

ROOF LEVEL BCI JOIST LAYOUT
FILE: 9-386-2 JOB: DELAERE

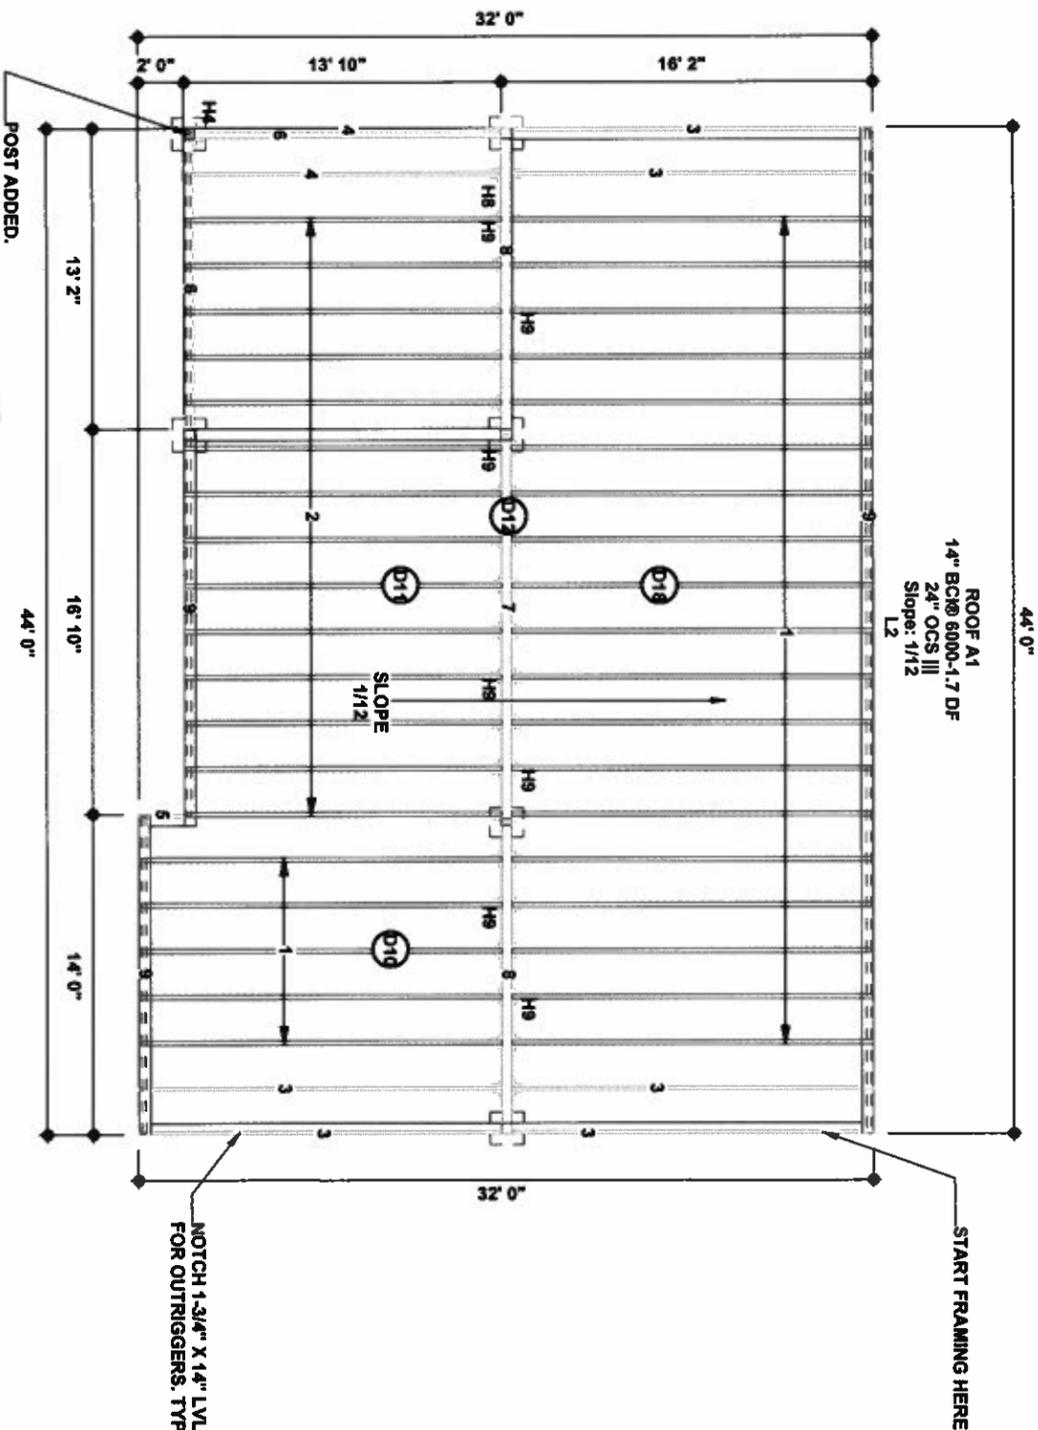

ROOF Framing Schedule - Normalized			
Tag	Qty	Description	Length
1	24	14" BCI@ 8000-1.7 DF	16' 0"
2	14	14" BCI@ 8000-1.7 DF	14' 0"
3	6	1-3/4" x 14" VERSA-LAM@ 2.0 2809 DF	16' 0"
4	2	1-3/4" x 14" VERSA-LAM@ 2.0 2800 DF	14' 0"
5	1	1-3/4" x 14" VERSA-LAM@ 2.0 2800 DF	3' 0"
6	2	5-1/8" x 12" BOISE GLULAM™ 24F-V4DF	14' 0"
7	1	5-1/8" x 19-1/2" BOISE GLULAM™ 24F-V4DF	17' 0"
8	2	5-1/8" x 19-1/2" BOISE GLULAM™ 24F-V4DF	14' 0"
9	BLK	14" BCI@ 8000-1.7 DF	88' 0"

ROOF Accessory Schedule				
Tag	Qty	Manufacturer	Product	Description
H4	1	Simpson Strong-Tie, Inc.	HUCCQ6.26/11-SDS	HUCCQ6.26/11-SDS2.6 CONC FIG HGR
H8	4	Simpson Strong-Tie, Inc.	LSSU125	SGL ADJ FACE MOUNT SLOPESKEW 25/CTN
H9	38	Simpson Strong-Tie, Inc.	LSSU135	SGL ADJ FACE MOUNT SLOPESKEW 25/CTN





D# DENOTES BC CALC REFERENCE TAG



Load Schedule							
Tag	Type	Live	Dead	Snow	Wind	Roof Live	Description
L2	Unf. Area	100%	90%	115%	133%	125%	Roof Load

CONTRACTOR NOTES:

- PLEASE VERIFY ALL DIMENSIONS
- ALL FOOTINGS PER DESIGNER'S PLAN UNLESS NOTED OTHERWISE (SEE LAYOUT)
- PER NEW IRC CODES BLOCKING IS REQUIRED AT ALL INTERMEDIATE BEARING
- USE CAUTION WHEN CUTTING FOR PLUMBING
- PROVIDE PROPER SUPPORT AT ALL SHEARWALLS
- ALL ROOF LOADS ASSUMED TO BEAR ON EXTERIOR WALLS ONLY, NO ROOF FRAMING PLAN PROVIDED AT TIME OF LAYOUT
- PLEASE NOTE P.T. MATERIAL CAN CAUSE HANGERS TO CORRODE
- Z-MAX, HOT GALVANIZED, OR STAINLESS STEEL HANGERS REQUIRED FOR USE WITH MANY TREATED PRODUCTS. PLEASE SEE MANUFACTURER'S RECOMMENDATIONS.
- RECOMMENDED DECKING:
 - 16" O.C.-3/4" DECKING MIN.
 - 24" O.C.-7/8" DECKING MIN.
 - 32" O.C.-1-1/8" DECKING MIN.
- PLEASE VERIFY ALL CONDITIONS, LAYOUT WAS PRODUCED FROM INCOMPLETE DESIGNER'S PLANS

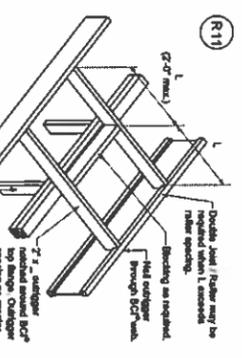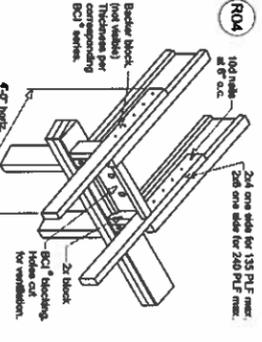

USAX Overhang Framing N.T.S.

F08 Post Load Transfer N.T.S.

USFD Wall Outrigger N.T.S.

REVISIONS:	BY:
5/4/09	BH
5/19/09	BH

SALES PRESENTATION DRAWING
No structural or dimensional check has been made with the design drawings of the building, therefore purchaser is to check and approve all dimensions, quantities, loads, and details carefully. This drawing has not been checked by Boise Engineering.



BC FRAMER@ 2.0
SCALE: 1/8" = 1'-0"
DATE: 5/19/2009
BY: BH
FILE: 9-386-2.bcf
DWG:
SHEET: 3 / 3

PROBUILD - THE DALLES
DELAERE
ROOF LEVEL BCI JOIST LAYOUT
BOISE CASCADE BMD
VANCOUVER, WA